
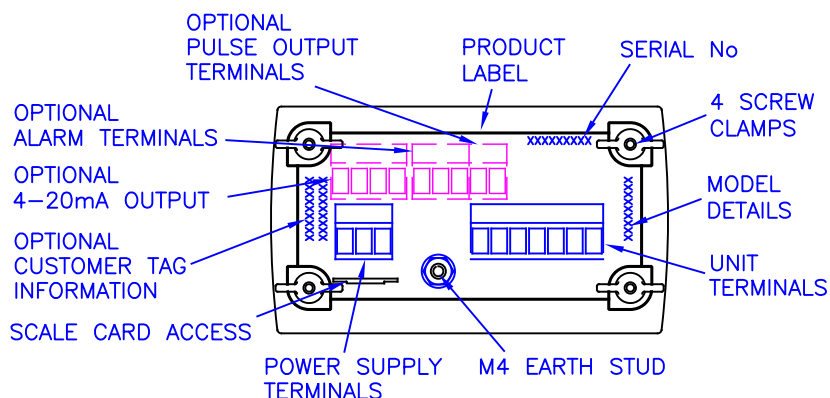



Iss.	Date	Modification	Ckd.	Appd.
1	10.05 2017	P0163. New drawing	.	.
.	.	.	.	.




**BEKA** *associates*  
Hitchin  
England  
company confidential, copyright reserved.


Iss.	Date	Modification	Ckd.	Appd.



TERMINAL CONNECTIONS:




OPTION TERMINALS (WHEN OPTION FITTED):



### INSTALLATION:

- 1 INSERT UNIT INTO PANEL CUTOUT FROM FRONT.
- 2 SCREW CLAMPS ARE FITTED OVER THE 4 STUDS & THE WING NUTS TIGHTENED FROM REAR OF PANEL.  
RECOMMENDED TORQUE 22cNm MIN.
- 3 FOR PANELS GREATER THAN 3mm THICK ADD ADDITIONAL DEPTH FOR CLAMPS.  
(ie ADD PANEL THICKNESS LESS 3mm)
- 4 FINALLY, FIT A SILICONE RUBBER CAP TO THE END OF EACH M3 THREADED ROD.



Title

CUSTOMER DRAWING for BA567E-SS  
1 INPUT COUNTER  
IN RUGGED PANEL MOUNTING ENCLOSURE

Drawn

RC

Checked

Scale

NTS

Drawing No.

CD567E-SS